

Sales & Sales Processing


QUESTIONNAIRE (11-18-2020)

PROCESSTEC
GET TOMORROW'S TECHNOLOGY TODAY

NAME: _____ DATE: _____
 COMPANY NAME: _____
 ADDRESS: _____
 CITY: _____ STATE: _____ ZIP CODE: _____
 PHONE: _____ FAX: _____ E-MAIL: _____

VESSEL DATA:

> Please Mark Corresponding Vessel Shape <

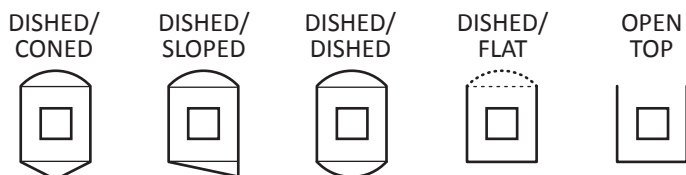

Nominal Volume: _____ m³ _____ gallons
 Eccentric: ☐ NO ☐ YES F _____ mm _____ inches
 Vessel Inner Diameter: d1 _____ mm _____ inches
 Vessel Outer Diameter: h1 _____ mm _____ inches
 Date Available as: ☐ STEP ☐ DXF ☐ PDF
 Vessel Heights:
 A _____ mm _____ inches D _____ mm _____ inches
 B _____ mm _____ inches E _____ mm _____ inches
 C _____ mm _____ inches

FLUID DATA:


Product Name: _____
 Mixing Task: ☐ HOMOGENIZING ☐ DISPERSING
☐ SUSPENDING ☐ KEEP IN MOTION

FLOW BEHAVIOUR:

Density: _____ Kg/m³ _____ lbs.
 Viscosity: _____ mPas _____ cps
 Solids Conc. _____ Weight-% _____ kg or lbs.
 Operating Temp
 Inside Vessel: _____ Celsius _____ Fahrenheit
 Max. Pressure/
 Depression: _____ bar, abs _____ psi

ADDITIONAL INFORMATION:

Ex-Protection: ☐ NO ☐ YES Division: _____
 Ex-Zone: ☐ Inside Vessel ☐ Outside Vessel Class: _____
☐ Single Phase: 110/120 VAC/60 Hz
☐ Single Phase: 220/240 VAC/60 Hz Air Motor: ☐ YES ☐ NO
☐ 3-Phase: 208/220 VAC/60 Hz
☐ 3-Phase: 460/480 VAC/60 Hz
 Performance: _____
 Designation: _____

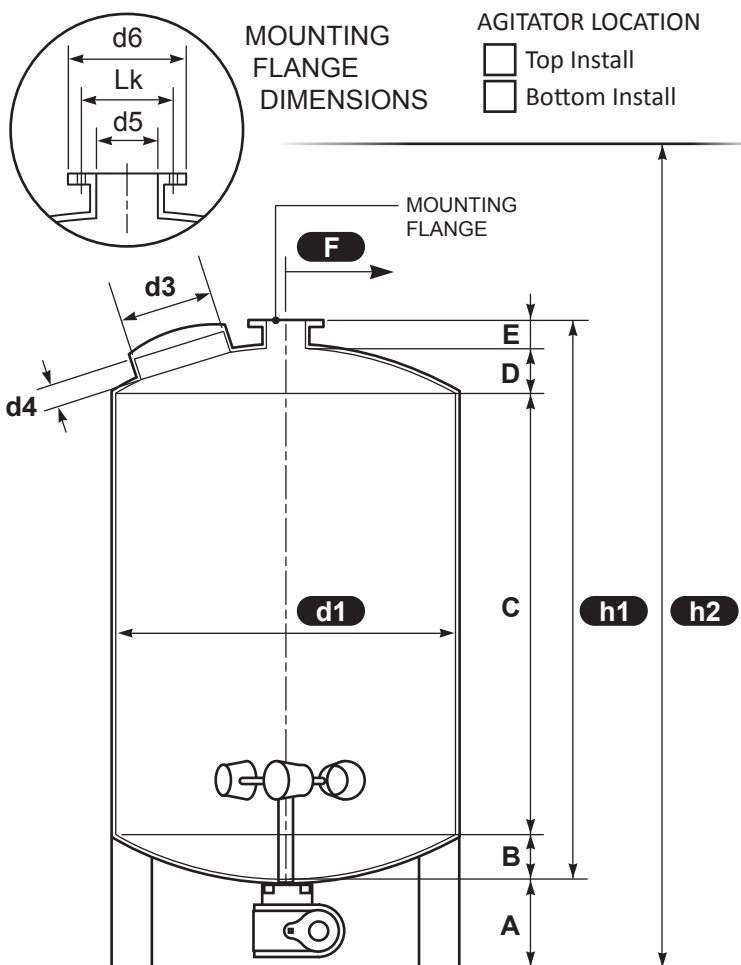

Height of the Room: h2 _____ mm _____ inches
 Manhole: d3 x d4 _____ mm _____ inches

MOUNTING FLANGE (INSTALLATION OF AGITATOR):

Inner Diameter of Flange: d5 _____ mm _____ inches
 Bolt Circle: Lk _____ mm _____ inches
 Outer Diameter of Flange: d6 _____ mm _____ inches

ADDITIONAL INFORMATION: