

# ViscoMix QUESTIONNAIRE

NAME: \_\_\_\_\_ DATE: \_\_\_\_\_  
 COMPANY NAME: \_\_\_\_\_  
 ADDRESS: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP CODE: \_\_\_\_\_  
 PHONE: \_\_\_\_\_ FAX: \_\_\_\_\_ E-MAIL: \_\_\_\_\_

## VESSEL DATA:

> Please Mark Corresponding Vessel Shape <



Nominal Volume: \_\_\_\_\_ m<sup>3</sup> \_\_\_\_\_ gallons  
 Eccentric:  NO  YES F \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Vessel Inner Diameter: d1 \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Vessel Outer Diameter: h1 \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Date Available as:  STEP  DXF  PDF  
 Vessel Heights:  
 A \_\_\_\_\_ mm \_\_\_\_\_ inches D \_\_\_\_\_ mm \_\_\_\_\_ inches  
 B \_\_\_\_\_ mm \_\_\_\_\_ inches E \_\_\_\_\_ mm \_\_\_\_\_ inches  
 C \_\_\_\_\_ mm \_\_\_\_\_ inches

## FLUID DATA:


Product Name: \_\_\_\_\_  
 Mixing Task:  HOMOGENIZING  DISPERSING  
 SUSPENDING  KEEP IN MOTION

### FLOW BEHAVIOUR:

Density: \_\_\_\_\_ Kg/m<sup>3</sup> \_\_\_\_\_ lbs.  
 Viscosity: \_\_\_\_\_ mPas \_\_\_\_\_ cps  
 Solids Conc. \_\_\_\_\_ Weight-% \_\_\_\_\_ kg or lbs.  
 Operating Temp  
 Inside Vessel: \_\_\_\_\_ Celsius \_\_\_\_\_ Fahrenheit  
 Max. Pressure/  
 Depression: \_\_\_\_\_ bar, abs \_\_\_\_\_ psi

## ADDITIONAL INFORMATION:

Ex-Protection:  NO  YES Division: \_\_\_\_\_  
 Ex-Zone:  Inside Vessel  Outside Vessel Class: \_\_\_\_\_  
 Single Phase: 110/120 VAC/60 Hz  
 Single Phase: 220/240 VAC/60 Hz Air Motor: \_\_\_\_\_  
 3-Phase: 208/220 VAC/60 Hz  YES  NO  
 3-Phase: 460/480 VAC/60 Hz  
 Performance: \_\_\_\_\_  
 Designation: \_\_\_\_\_

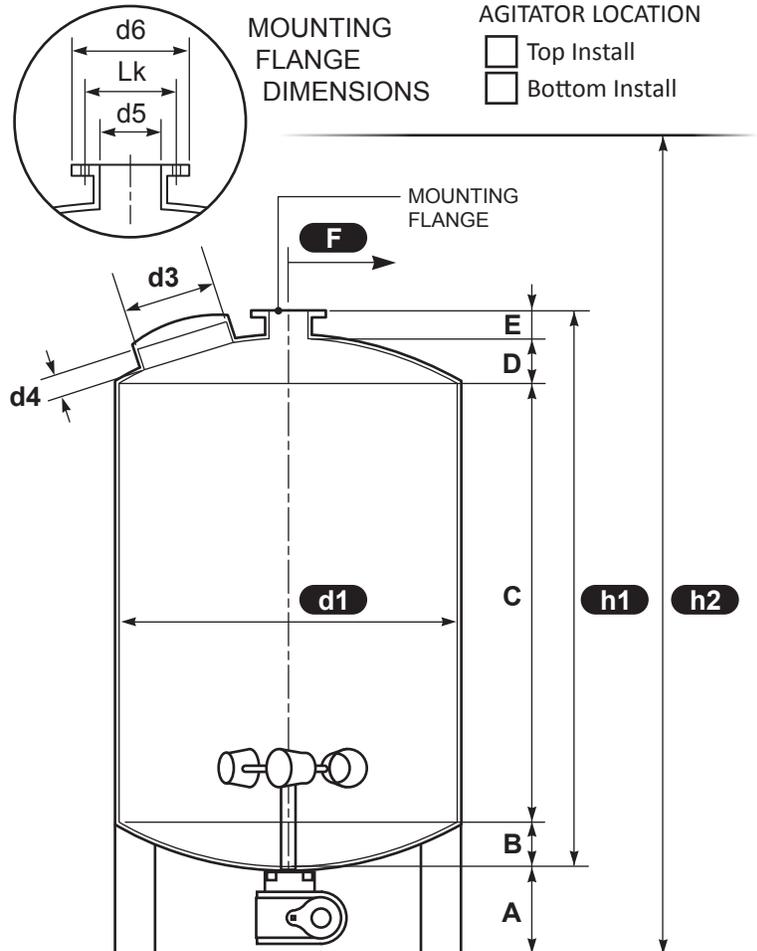

Height of the Room: h2 \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Manhole: d3 x d4 \_\_\_\_\_ mm \_\_\_\_\_ inches

### MOUNTING FLANGE (INSTALLATION OF AGITATOR):

Inner Diameter of Flange: d5 \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Bolt Circle: Lk \_\_\_\_\_ mm \_\_\_\_\_ inches  
 Outer Diameter of Flange: d6 \_\_\_\_\_ mm \_\_\_\_\_ inches

### ADDITIONAL INFORMATION: